
Light Control

Operation and Display

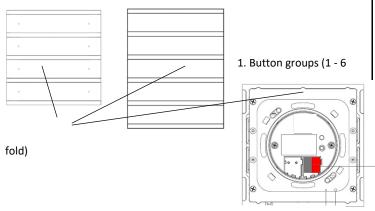

- 1. KNX connection terminal
- 2. KNX programming button
- 3. KNX programming led

Description of the Device

Oria premium push-button and thermostat series create a natural harmony and adds value to your interior designs with elegant look and sophisticated technology. Combined with KNX system, use of a single Oria switch would provide you the means to activating light scenes, controlling blinds and setting a comfortable temperature. Oria series which combine the familiar push button feeling with the latest technology are available in anthracite, ivory and cloud gray colours.

- 60x60 mm easy mounting to standard junction boxes.
- 6 rockers can be programmed to perform different functions.
 - Switching
 - Dimming
 - Shutter/Blind
- Value
- Scene control
- Status notification

Technical Data

Installation


Installation of the product is done with the help of the flange which is inside the box. The

		M
Type of protection	IP 20	11
Safety class		
KNX Supply (1)	- Voltage	9
	- Current	
Connections	-KNX	8
Installation	60x60 mn	
Temperature range	Ambient	
	Storage	0
Humidity	Max. air h	بالب
	condensation	
Dimensions	Front face (1-4fold) 90x90 mm	
	Front face (5 fold) 90x112 mm	
	Front face (6 fold) 90x133 mm	
	Side- Surface of plaster 8,5 mm	
	Side- Under plaster 29,5 mm	
Вох	Plastic, polycarbonate	
CE	In accordance with the EMC guideline and low	1
	voltage	
Application Program	Communication Objects 50	
	Number of Addresses(max) 254	

flange is fixed to the junction box by using screws while the arrows on flange are headed to up. The switch is placed into the junction box by positioning the EAE logo upwards and then reclining it to the flange. The switch is slowly turned clockwise to give the right position to it on the

Number of assignments(max)

flange. After the clicks are on the right position, switch is turned counterclockwise to lock ______ it on the flange.



Commissioning

Device default physical address is 15.15.255. Determination of the physical address and setting of parameters are actualized with Engineering Tool Software (ETS3/ETS4 or higher). ".knxprod" file must be imported to the ETS. (http://www.Lightcontrol-knx.com/)

A detailed information about parameter configuration can be found in Product Manual of device.

Installation and commissioning of device may only be implemented by trained electricians. The relevant standards, directives, regulations and instructions must be observed when planning and implementing the electrical installation.

- -Protect the device against moisture, dirt and damage during transport, storage and operation!
- -Do not operate the device out of the specified technical data which is stated.
- -The device may only be operated in closed enclosures (Distribution boards)

Cleaning

If device becomes dirty, only a dry cloth can be used for cleaning. It is not suitable to use wet cloths, caustics and solvents.